



# **Architectural Design Series Concealed Flush**

## 1800D60TR-48



1.27 gpf (4.8 Lpf) Flush Volume, Infrared Sensor, Chrome Finish, Hardwire Operated, Water Closet Fixture, Electronic Manual Override, Front Accessible Rough-In Box

### **Specifications**

Flush Volume: Fixed @ 1.27 gpf (4.8 Lpf)

Sensor Type: Infrared

· Finish: Chrome

Power Supply: Hardwire Operated (24 VAC) requires transformer (sold separately)

Fixture Type: Water Closet Override: Electronic Manual Rough-In Box: Front Accessible

#### **Features**

- · Cover with integral sensor
- · Vandal-resistant mounting plate, installed with single hidden screw
- · No visible mounting hardware
- · TRIM MODELS Supplied as sensor and override button attached to cover
- Preset blocking time, built-in activation delay
- Oversized ADA compliant push button

#### Required Accessories

- 060704A Transformer 120 to 24 VAC Class 2 20 VA
- 060771A Transformer 120 to 24 VAC Class 2 40 VA

### **Optional Accessories**

061704A - Hardwire with Battery Backup - (See DSP-BB for detailed specification)



#### **Complies With**

- ASSE 1037/ ASME A112.1037/ CSA B125.37
- ICC/ANSI A117.1
- EPA WaterSense®





(Contact Delta Representative for State and/or Local Approvals)

#### Operation

- · Hands free touch-less operation
- Power function light
- Selectable sensing distance 24" to 56" (610 to 1422 mm) in 8" (203 mm) increments factory set to 40" (1016 mm)
- · 12 seconds blocking time

#### **Notes**


· Rough-in (1800D60RI) ordered separately






# Architectural Design Series Concealed Flush Valve

## 1800D60TR-48

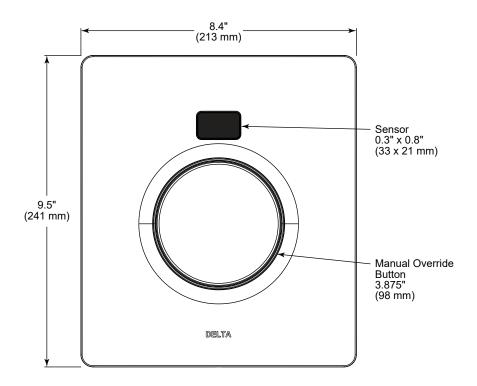

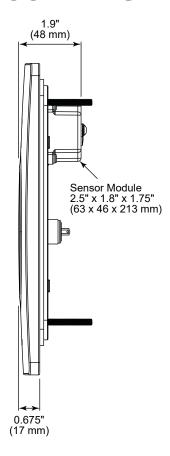

Delta Commercial flushometer valves are designed to operate at a supply pressure between 20 psi and 125 psi in accordance with ASSE 1037/ASME A112.1037/CSA B125.37. At high water pressures, splash out, noise or reduced life of plumbing components may be observed with a few models of water closet or urinal fixtures. To minimize, or eliminate these effects, select a different model of water closet or urinal fixture from the same or different manufacturer, or install a pressure reducing valve. If the installation does not allow for either of these options, the ball valve adjustment may be used to reduce peak flow to the valve.