

Type _____


-10

P3652 ☐

P3653 ☐

P3654 ☐

Catalog No.	Finish		Dimensions (Inches)	
	White	Lamping	A	B
P3652	-30	2 (m) 60w	10-1/2	6-1/2
P3653	-30	2 (m) 75w	12-1/2	7-1/4
P3654	-30	3 (m) 60w	14-1/2	7-3/4

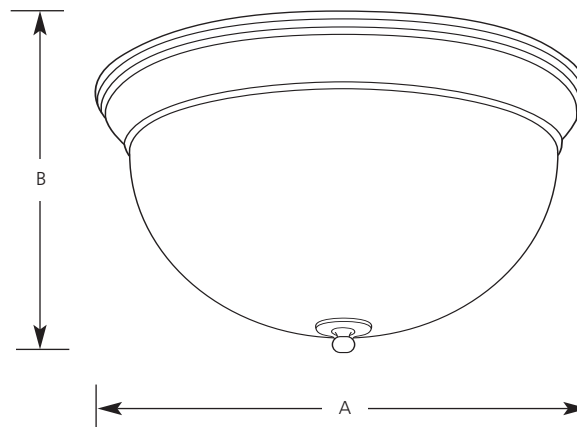

Specifications:

General

- Steel construction
- White painted (-30) finishes
- Steel pan
- White glass
- P3652: 8-11/32" dia., 7-7/8" OD Lip x 4-1/2" ht., 7/16" hole dia.
- P3653: 10-5/16" dia., 9-15/16" OD neck, 9-1/4" ID neck, 5-1/4" ht., 7/16" hole dia.
- P3654: 12-1/2" dia., 11-3/4" OD neck, 10-15/16" ID neck, 6-3/32" ht., 1/2" hole dia.
- Glass has center lock up for maintenance
- Fiberglass insulated

Mounting

- Ceiling mount
- Covers outlet box
- Mounting strap for outlet box included
- Keyhole slots for easy mounting

Electrical

- Requires 90-degree supply wire connections
- Ceramic medium based sockets
- Pre-wired

Labeling

- UL-CUL listed

P3652

WHITE GLASS - FLUSH MOUNT



Report No. 2000031

No. Lamps: 2 Type Lamp: 60A19-GE Total Lumens: 1730

Fixture Efficiency: 64.8%


S/MH Ratio: 1.3

Quick Calculator Charts

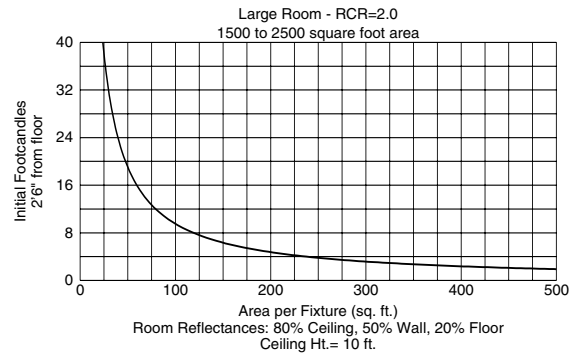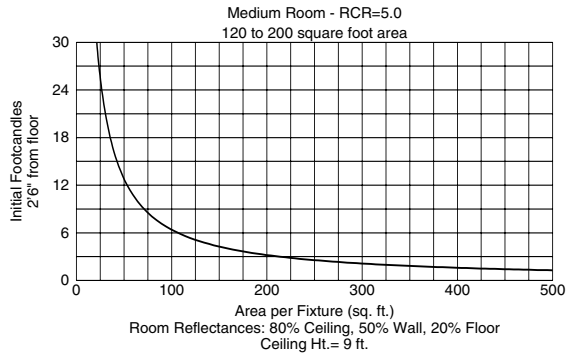

DISTRIBUTION CURVE

INTENSITY DATA

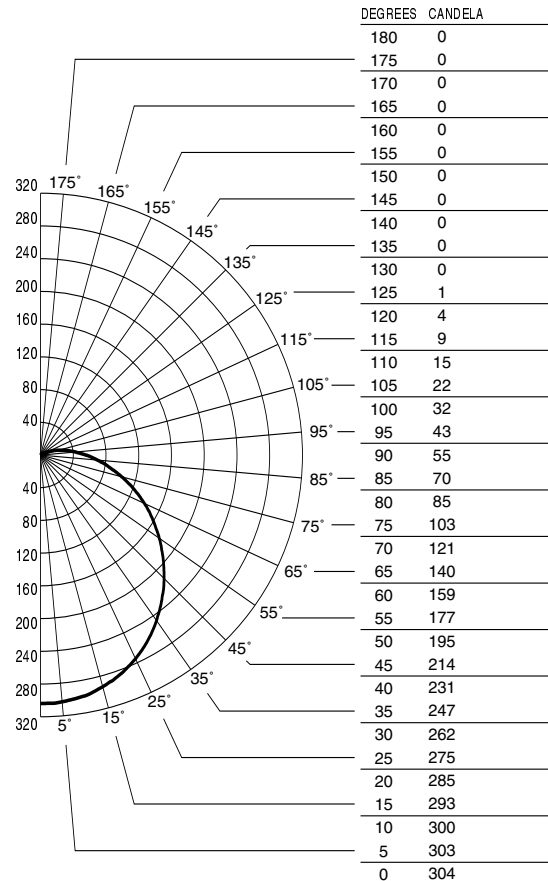

Single Fixture Data

	10% Values		Zero Degrees	50% Values	
Ceiling Ht.(Ft.)	Beam Angle - 112°			Beam Angle - 65°	
	Ft.-C	Beam Dia.		Ft.-C	Beam Dia.
8	1.0	16	10.0	5.0	7
10	0.5	22	5.4	2.7	10
12	0.3	28	3.4	1.7	12
14	0.2	34	2.3	1.1	15
16	0.2	40	1.7	0.8	17

Ft.-C (Footcandles) are initial and measured 2'-6" from floor

ZONAL CAVITY COEFFICIENTS OF UTILIZATION

Effective Floor Cavity Reflectance 0.20																					
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0			
0	76	76	76	76	74	74	74	74	69	69	69	66	66	66	62	62	62	60			
1	68	64	61	57	65	62	59	56	58	56	53	55	53	51	52	50	49	47			
2	61	55	50	46	59	53	49	45	50	46	43	47	44	41	45	42	40	38			
3	55	48	42	37	53	46	41	37	44	39	35	41	37	34	39	36	33	31			
4	50	42	36	31	48	41	35	31	39	34	30	36	32	29	34	31	28	26			
5	46	37	31	27	44	36	31	26	34	29	25	33	28	25	31	27	24	22			
6	43	34	27	23	41	33	27	23	31	26	22	29	25	22	28	24	21	20			
7	39	30	24	20	38	30	24	20	28	23	20	27	22	19	25	22	19	17			
8	37	28	22	18	35	27	22	18	26	21	17	24	20	17	23	19	17	15			
9	34	25	20	16	33	25	19	16	24	19	16	23	18	15	22	18	15	14			
10	32	23	18	15	31	23	18	14	22	17	14	21	17	14	20	16	14	12			

P3653

WHITE GLASS - FLUSH MOUNT



Report No. 2000008

No. Lamps: 2 Type Lamp: 75A19-GE Total Lumens: 2380

Fixture Efficiency: 58.8%


S/MH Ratio: 1.3

Quick Calculator Charts

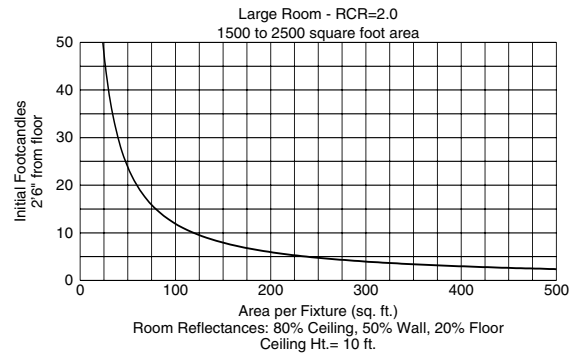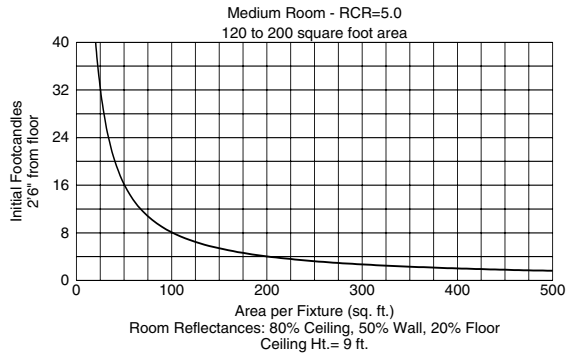

DISTRIBUTION CURVE

INTENSITY DATA

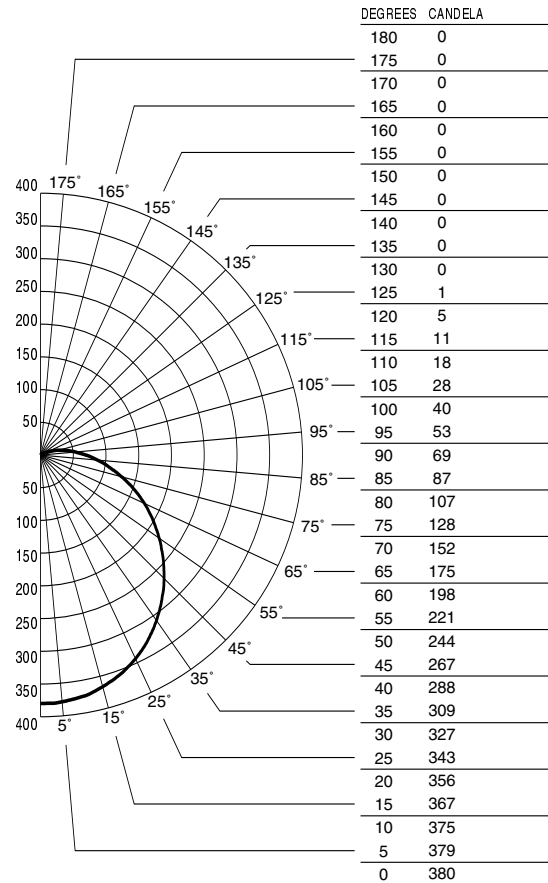

Single Fixture Data

	10% Values		Zero Degrees	50% Values	
Ceiling Ht.(Ft.)	Beam Angle - 112°			Beam Angle - 65°	
	Ft.-C	Beam Dia.		Ft.-C	Beam Dia.
8	1.3	16	12.6	6.3	7
10	0.7	22	6.8	3.4	10
12	0.4	28	4.2	2.1	12
14	0.3	34	2.9	1.4	15
16	0.2	40	2.1	1.0	17

Ft.-C (Footcandles) are initial and measured 2'-6" from floor

ZONAL CAVITY COEFFICIENTS OF UTILIZATION

Effective Floor Cavity Reflectance 0.20																						
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
0	69	69	69	69	67	67	67	67	63	63	63	59	59	59	56	56	56	55				
1	61	58	55	52	59	56	53	51	53	51	48	50	48	46	47	45	44	42				
2	55	50	45	41	53	48	44	40	45	42	39	43	40	37	40	38	36	34				
3	50	43	38	34	48	42	37	33	40	35	32	37	34	31	35	32	30	28				
4	46	38	33	28	44	37	32	28	35	30	27	33	29	26	31	28	25	24				
5	42	34	28	24	40	33	28	24	31	27	23	30	26	22	28	25	22	20				
6	39	30	25	21	37	30	24	21	28	24	20	27	23	20	25	22	19	18				
7	36	27	22	18	34	27	22	18	25	21	18	24	20	17	23	20	17	16				
8	33	25	20	16	32	24	20	16	23	19	16	22	18	15	21	18	15	14				
9	31	23	18	15	30	22	18	14	21	17	14	20	17	14	20	16	14	12				
10	29	21	16	13	28	21	16	13	20	16	13	19	15	13	18	15	12	11				

P3654

WHITE GLASS - FLUSH MOUNT



Report No. 2000032

No. Lamps: 3 Type Lamp: 60A19 GE Total Lumens: 2595


Fixture Efficiency: 53.1%

S/MH Ratio: 1.3

Quick Calculator Charts

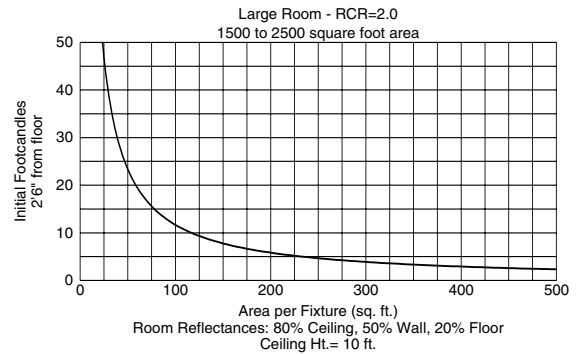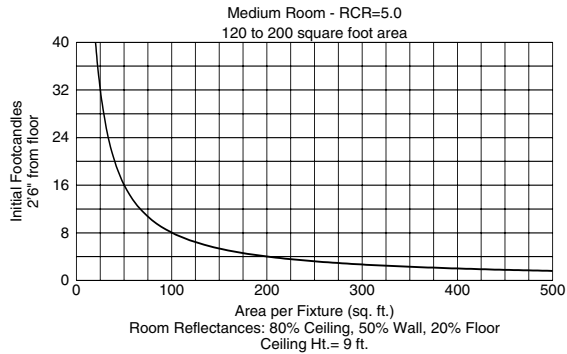

DISTRIBUTION CURVE

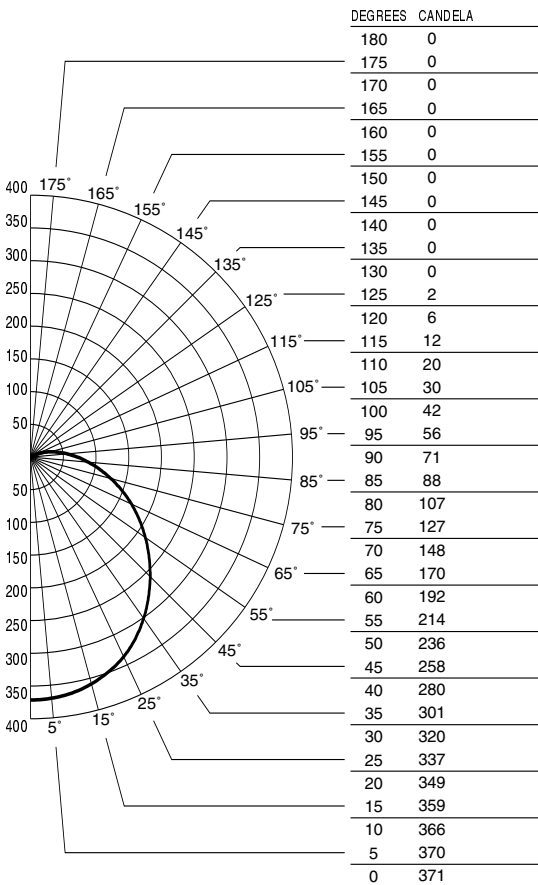

INTENSITY DATA

Single Fixture Data

	10% Values		Zero Degrees	50% Values	
Ceiling Ht.(Ft.)	Beam Angle - 112°			Beam Angle - 65°	
	Ft.-C	Beam Dia.		Ft.-C	Beam Dia.
8	1.2	16	12.3	6.1	7
10	0.7	22	6.6	3.3	10
12	0.4	28	4.1	2.1	12
14	0.3	34	2.8	1.4	15
16	0.2	40	2.0	1.0	17

Ft.-C (Footcandles) are initial and measured 2'-6" from floor

ZONAL CAVITY COEFFICIENTS OF UTILIZATION

		Effective Floor Cavity Reflectance 0.20															
		80				70				50				30			
RC	RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30
0	0	62	62	62	62	60	60	60	60	57	57	57	53	53	53	50	50
1	1	55	52	49	47	53	51	48	46	48	45	44	45	43	41	42	41
2	2	50	45	41	37	48	43	40	36	41	38	35	38	36	33	36	34
3	3	45	39	34	30	43	38	33	30	36	32	29	34	30	28	32	29
4	4	41	34	29	25	40	33	29	25	31	27	24	30	26	23	28	25
5	5	38	31	25	22	36	30	25	21	28	24	21	27	23	20	25	22
6	6	35	27	22	19	34	27	22	19	25	21	18	24	20	18	23	20
7	7	32	25	20	17	31	24	20	16	23	19	16	22	18	15	21	18
8	8	30	23	18	15	29	22	18	14	21	17	14	20	16	14	19	16
9	9	28	21	16	13	27	20	16	13	19	15	13	18	15	12	18	14
10	10	26	19	15	12	25	19	14	12	18	14	11	17	14	11	16	13