


## INSTRUCTIONS FOR MODELS

### STW-370

#### Thermostatic Mixing Valve

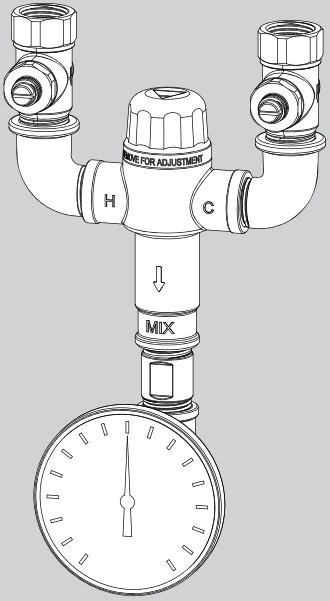

#### NEED HELP?

For additional assistance or service please contact:

**SPEAKMAN®**


800-537-2107

customerservice@speakman.com

www.speakman.com

92-STW-370-04

## TOOLS AND SUPPLIES

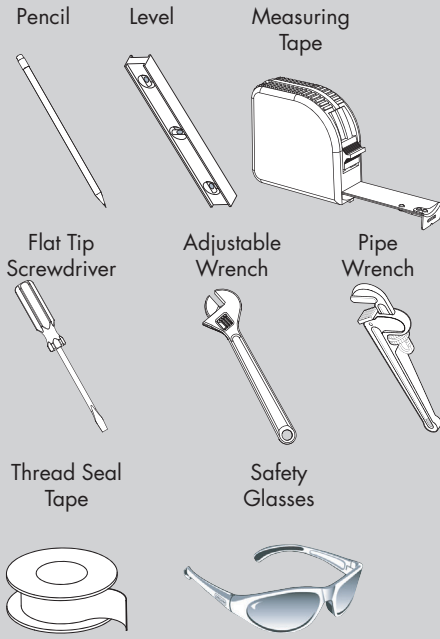

#### HELPFUL TOOLS & SUPPLIES:

- Lockable shut-off on the outlet supply if tempered water is supplied to one or more emergency fixtures.
- Lockable shut-off on the inlets/supplies.
- Unions on all connections to facilitate removal of valve.



## IMPORTANT



- Compliance and conformity to local codes and ordinances is the responsibility of the installer.
- Valve should be accessible for testing, adjustment and maintenance in the installed position.
- Make sure that all water supply lines have been flushed and then completely turned off before beginning installation. Debris in supply lines can cause valves to malfunction.
- Ensure the mounting structure and mounting hardware can safely support the product in use.
- Do not over-tighten any connections or damage may occur.
- Be sure to read instructions thoroughly before beginning installation.
- Installers shall verify that no single emergency fixture supplied by this device has a minimum flow rate less than 1.5 GPM (5.7 L/min).

**NOTE:** Valve must be installed with check valves. If shut off valves are installed in the supply line for maintenance purposes, provisions shall be made to prevent unauthorized shut off.



## IMPORTANT



#### SAFETY TIPS

Be sure to wear eye protection.

#### MAINTENANCE

See section "Testing the Mixing Valve".

#### WARRANTY

Warranty information can be found at: [www.speakman.com](http://www.speakman.com)

## 1A




### INSTALLING INTO CABINET

#### NOTE:

- If installing into Cabinet, see installation manual provided with Cabinet before proceeding.

#### Connect Supply Lines and Fixtures.

- Ensure incoming water supplies are turned OFF.
- Apply Thread Seal Tape to Inlet and Outlet pipe threads in a clockwise manner.
- Install the COLD Inlet pipe to the "C" Inlet on Valve.
- Install the HOT Inlet pipe to the "H" Inlet on Valve.
- Install Outlet connection to the Valve.
- Wrench tighten connections.

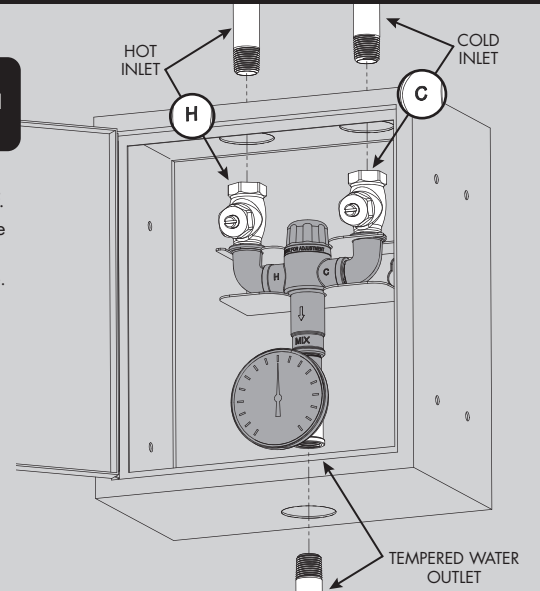

**WARNING:** The Valve will not function in the way it is intended to if Cold water supply pipe is connected to "H" Inlet on Valve and Hot water supply pipe is connected to "C" inlet on Valve.

## 1B



### INSTALLING WITHOUT CABINET

#### NOTE:

- If not installing into Cabinet, the Valve can be installed vertically with either the inlets at the top (as shown), or the inlets at the bottom depending on the location of inlet water supplies.

#### Connect Supply Lines and Fixtures.

- Ensure incoming water supplies are turned OFF.
- Apply Thread Seal Tape to Inlet and Outlet pipe threads in a clockwise manner.
- Install the COLD Inlet pipe to the "C" Inlet on Valve.
- Install the HOT Inlet pipe to the "H" Inlet on Valve.
- Install Outlet connection to the Valve.
- Wrench tighten connections.

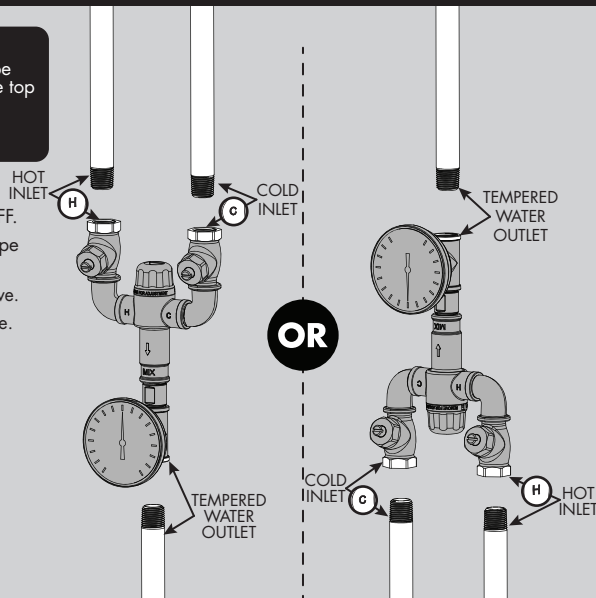



OR

**WARNING:** The Valve will not function in the way it is intended to if Cold water supply pipe is connected to "H" Inlet on Valve and Hot water supply pipe is connected to "C" inlet on Valve.

## 2


- Check for leaks by pressurizing the unit SLOWLY.
- Check the temperature when approx. 3-5 GPM water flow is reached (equivalent to one eye wash or face wash) and adjust if necessary.
- When the Check Stops are in the fully open (operating) position, the Stem will extend approximately 3/8" (9.5mm) from the Stem Nut.

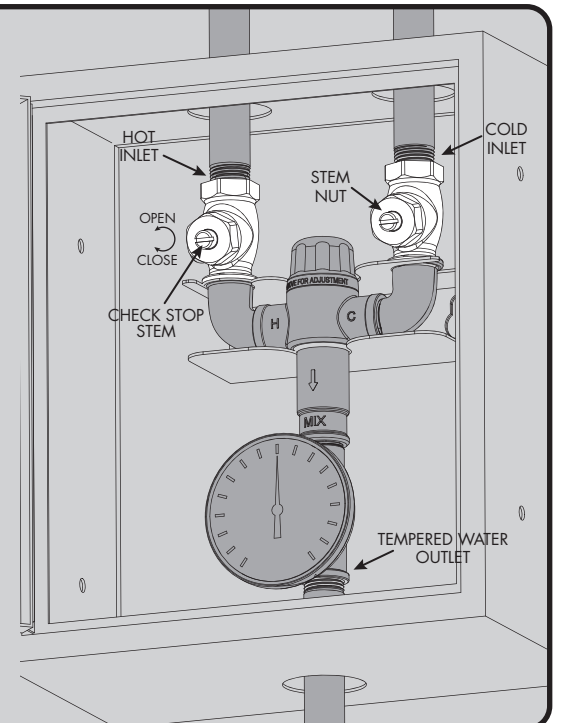

## 3

### SETTING THE MIXING VALVE


REMOVE THE CAP WITH FLAT TIP SCREWDRIVER FROM THE NOTCH ON THE CAP

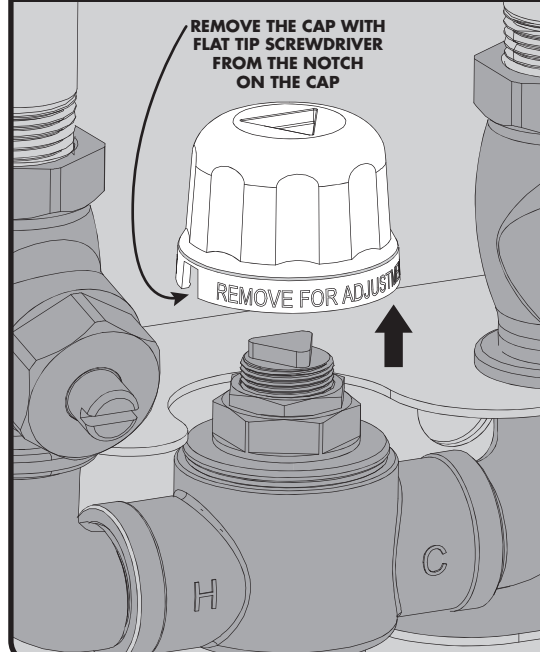

This Mixing Valve has been set at the factory to deliver 85 °F outlet flow. High temperature limit is set to 94 °F by design. Should the Valve require adjustment, or an application require a different set temperature, proceed as follows:

#### Adjust Temperature with Water Running

- Check the temperature when approximately 3-5 GPM water flow is reached (equivalent to one eye wash).
- Contact proper medical and safety authorities to determine the correct water temperature for the specific application (i.e., chemicals).
- Remove the Plastic Cap (White) from the Valve using a flat tip screwdriver.



## CAUTION




**1:** When maintaining and adjusting the Mixing Valve, all fixtures should be isolated from use. Speakman recommends that appropriate personnel shall work safely at all times and in a manner consistent with the OSHA Lock/Tag out standard, 29 CFR 1910.147 and other applicable standards.

**2:** When maintaining and adjusting the Mixing Valve, the delivered flushing fluid temperature shall be in the tepid range as per ANSI/ISEA Z358.1 Standard. In circumstances where chemical reaction is accelerated by flushing fluid temperature, a medical advisor should be consulted for the optimum temperature for each application.

4

## SETTING THE MIXING VALVE

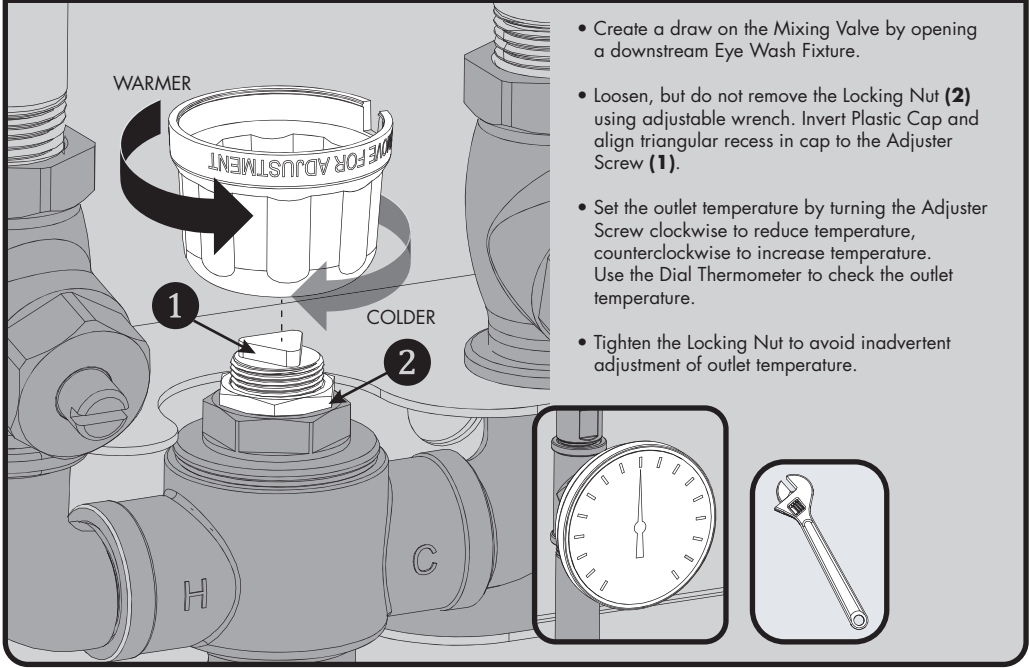

5

## TESTING THE MIXING VALVE

**After installation, test the Mixing Valve and the Emergency Fixtures it serves for proper operation by following the steps below. Testing shall be performed weekly and logged to comply with applicable codes and standards.**

**Valve temperature test procedure is as follows:**

1. Activate Eye Wash Fixture to observe and record the temperature of the Dial Thermometer. If the temperature of the Thermometer is not correct, readjust the Mixing Valve according to the section "Setting the Mixing Valve".
2. Observe the flow from the Emergency Fixture to ensure an adequate flow of water.

**Hot Water Shut-off Test and Cold Water Shut-off Test Procedures:**

1. Test Valve temperature as described in Step 1 and Step 2 above.
2. Shut off the hot water supply to the Mixing Valve. Observe the outlet flow from the Emergency Fixtures to ensure an adequate flow of cold water. A slight drop in flow may occur after shutting down the hot water supply to the Mixing Valve; however, the drop should be minimal and for a short duration.
3. Open the hot water supply to the Mixing Valve. The Thermometer should return to the set temperature.
4. Shut off the cold water supply to the Mixing Valve. The flow of water should shut down rapidly.
5. Open the cold water supply. The Thermometer should return to the set temperature.

**The Thermometer should be checked at least every six months.**

6

## REPLACING THE THERMOSTATIC ELEMENT

**The Thermostatic Element's replacement procedure is as follows:**


1. Shut off the hot water supply and cold water supply to the Mixing Valve.
2. Remove the Plastic Cap and disassemble the Valve Cap.
3. Remove Thermostatic Element in conjunction with the Shuttle from the Valve Body. No special tools are required.
4. Inspect the Thermostatic Element.  
If it feels slippery to the touch, then the Element has lost its wax and requires replacement. Disengage the Thermostatic Element from the Shuttle to replace.  
If the Thermostatic Element feels normal to the touch, then it is in good condition and operable.
5. Verify that the stainless steel Piston moves freely up and down within the Element's body.

### Note:


Gallon per minute ratings may vary depending upon incoming water temperatures and pressures. Hot and cold water inlet pressures must be equal.

Provisions shall be made to thermally isolate the valve.

## STW-370 RECOMMENDED STANDARD INSTALLATION SYSTEM

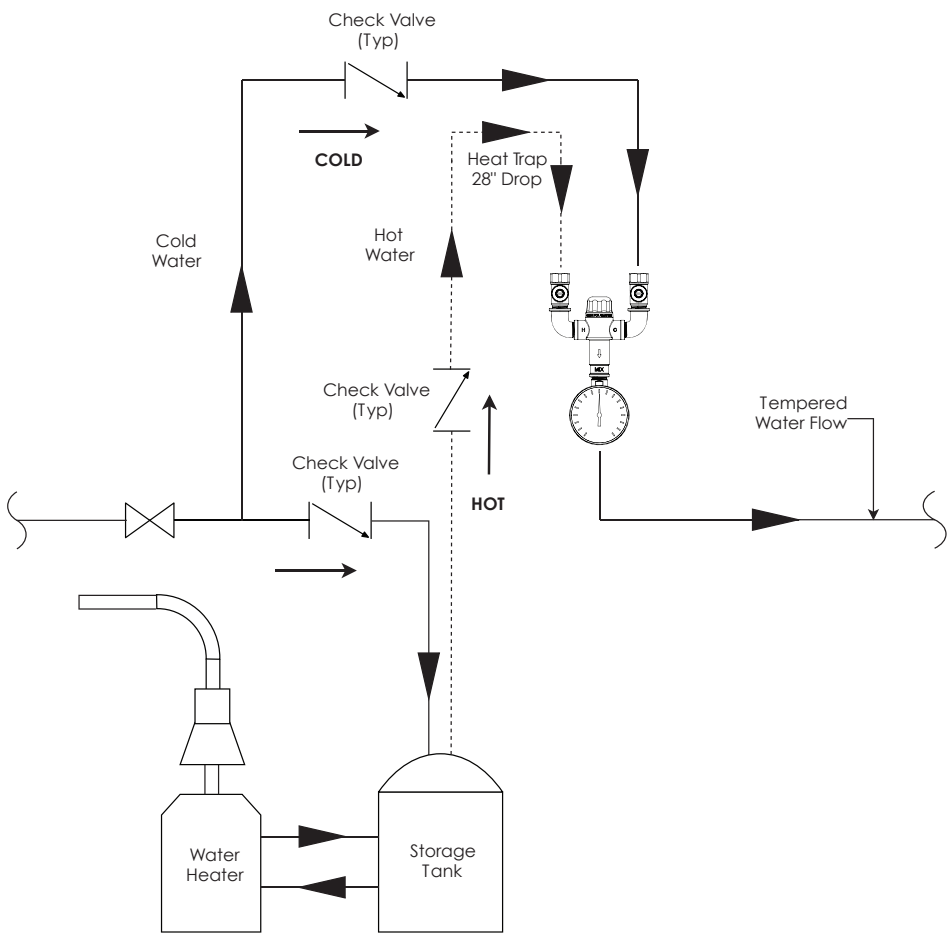

## STW-370 RECOMMENDED RE-CIRCULATORY INSTALLATION SYSTEM

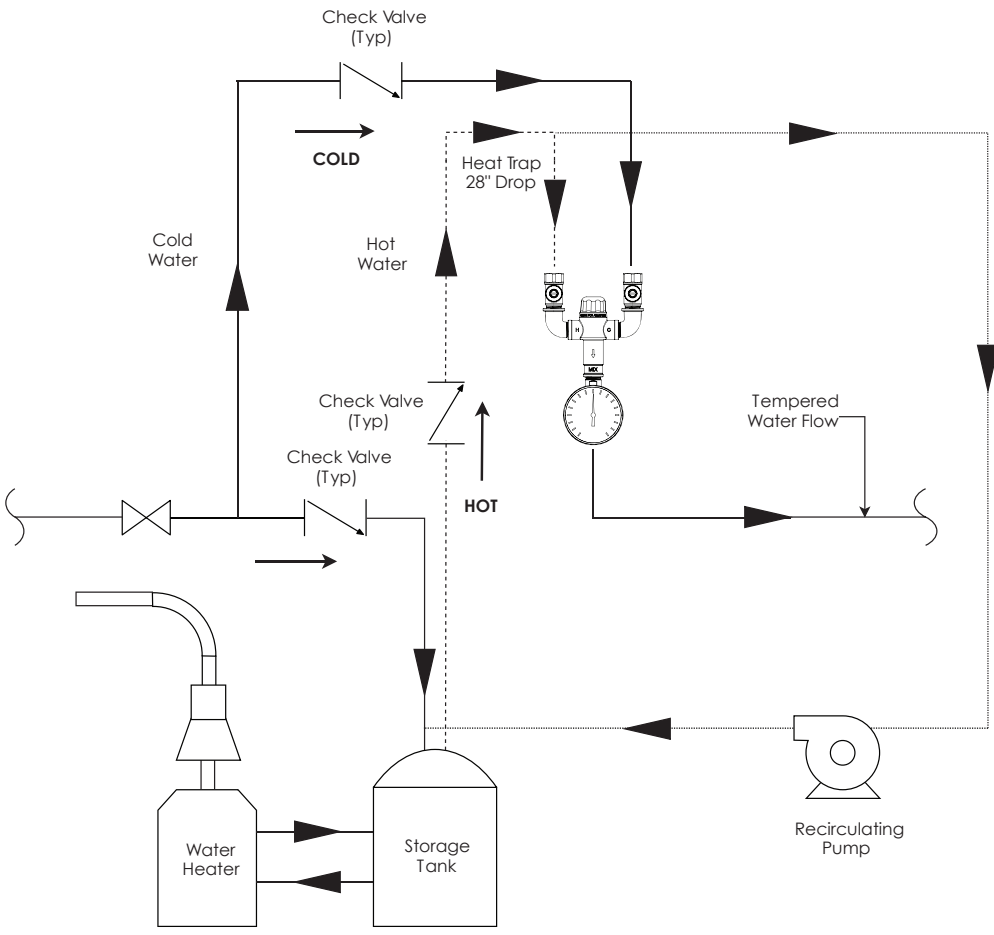

NOTES:


COMPLIANCE:

- ASSE 1071 & cUPC Certified  
NSF 372 Certified
- Inlets: ½" NPT Female
  - Outlet: ½" NPT Female
  - Maximum Working Pressure: 125 psi (861.9 kPa)
  - Rated flow at 30 psi (206.9 kPa) differential pressure: 9.7 GPM (36.8 L/min)
  - Rated cold water by-pass flow at 30 psi (206.9 kPa) differential pressure: 5.2 GPM (19.7 L/min)
  - Minimum flow rate: 1.5 GPM (5.7 L/min)
  - Maximum flow rate with cold water shut-off: 0.3 GPM (1.2 L/min)
  - Hot Water Inlet Temperature Range: 120 °F – 180 °F
  - Cold Water Inlet Temperature Range: 40 °F – 70 °F
  - Outlet Water Temperature Range: 65 °F – 95 °F
  - Minimum Temperature Differential (cold water supply to valve set point): 10 °F
- Contractor to supply necessary inlet connections.


FLOW CAPACITY OF STW-370

| PRESSURE DROP,     | psi (bar)   | 5<br>(0.4)    | 10<br>(0.7)   | 15<br>(1.0)   | 20<br>(1.4)   | 30<br>(2.1)   | 40<br>(2.8)    | 45<br>(3.1)    |
|--------------------|-------------|---------------|---------------|---------------|---------------|---------------|----------------|----------------|
| TEMPERED FLOW,     | GPM (L/min) | 3.6<br>(13.6) | 5.8<br>(22.0) | 7.2<br>(27.3) | 8.2<br>(31.1) | 9.7<br>(36.8) | 11.3<br>(42.8) | 12.2<br>(46.2) |
| COLD WATER BYPASS, | GPM (L/min) | 1.8<br>(6.8)  | 2.8<br>(10.6) | 3.6<br>(13.6) | 4.2<br>(15.9) | 5.2<br>(19.7) | 6.0<br>(22.7)  | 6.4<br>(24.3)  |

DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE.

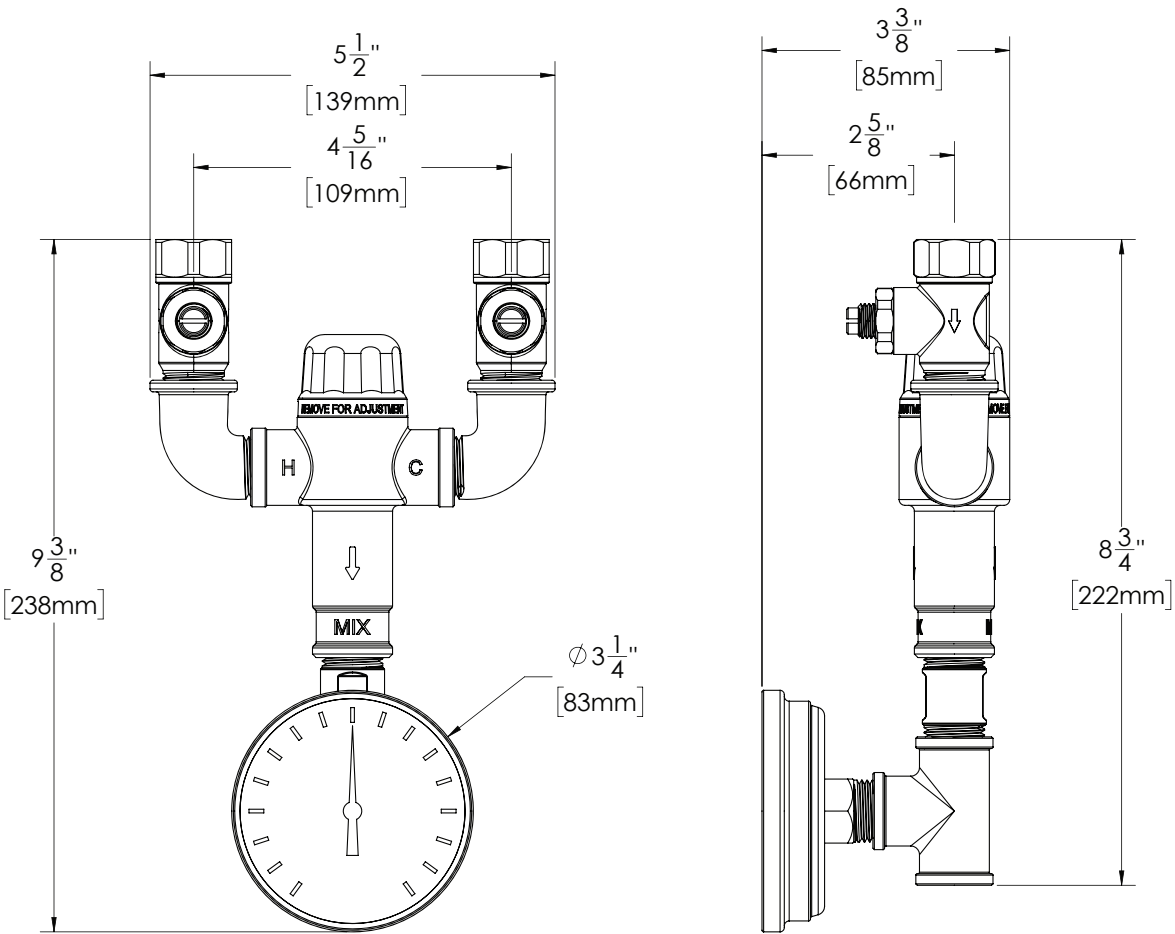

STW-370 REPAIR PARTS

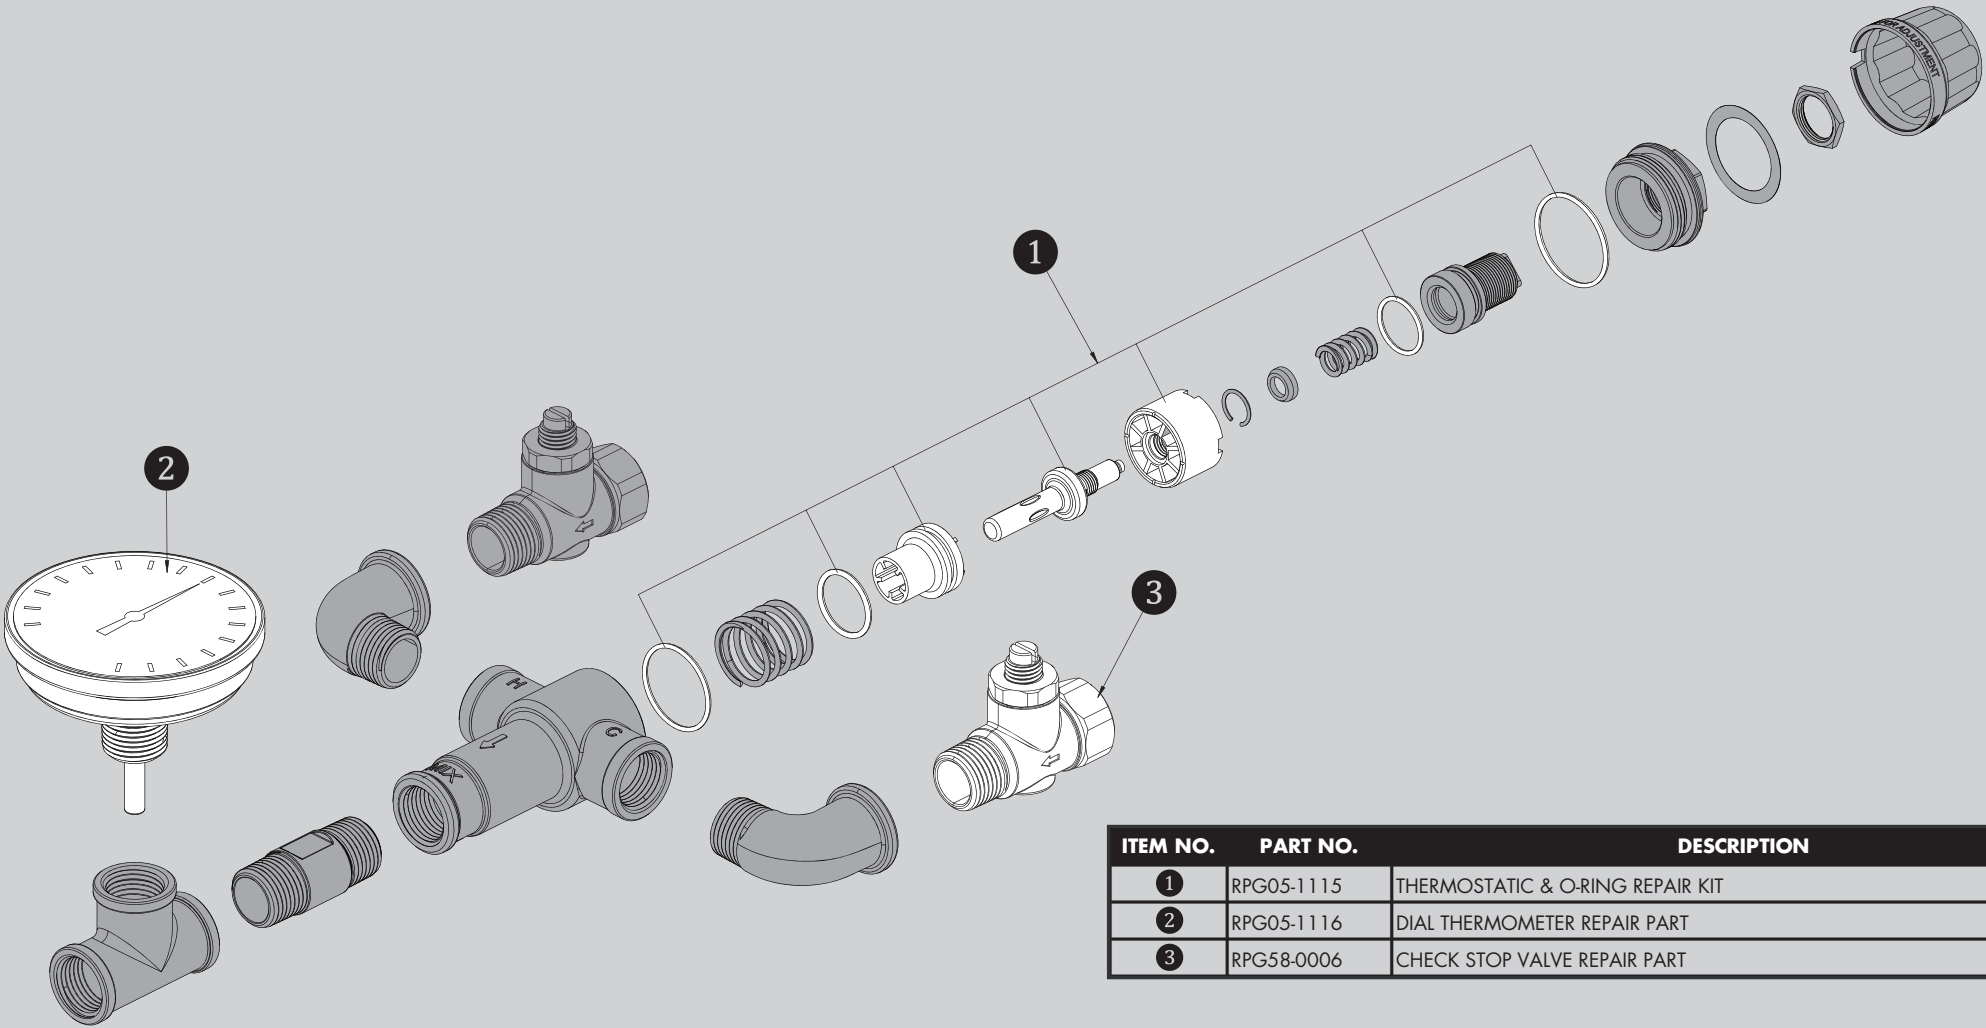

| ITEM NO. | PART NO.   | DESCRIPTION                      |
|----------|------------|----------------------------------|
| 1        | RPG05-1115 | THERMOSTATIC & O-RING REPAIR KIT |
| 2        | RPG05-1116 | DIAL THERMOMETER REPAIR PART     |
| 3        | RPG58-0006 | CHECK STOP VALVE REPAIR PART     |